

## SENSOTEC Sensor Monoblock

110042808	SENSOTEC MB HF1 COM1
110051733	SENSOTEC MB HF1 DALI-2
110059684	SENSOTEC MB HF2 COM1
110059685	SENSOTEC MB HF2 DALI-2



**MB HF1 COM1**




HF sensor with patch antenna for max. 5m detection range and 230V relay control.

**MB HF2 COM1**



HF sensor with rod antenna for max. 8m detection range and 230V relay control.

**MB HF1 DALI-2**

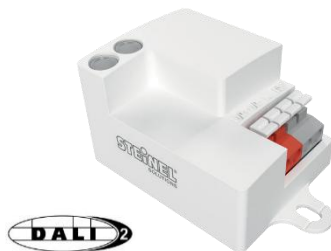

HF sensor with patch antenna for max. 5m detection range and DALI control with constant light control.

**MB HF2 DALI-2**



HF sensor with rod antenna for max. 8m detection range and DALI control with constant light control.

### Monoblock product family

Monoblock sensors are compact sensors with highly developed HF antenna technology and integrated controllers. They enable simple and energy-efficient local luminaire control.

The Monoblock product family includes the sensors MB HF1 COM1, MB HF1 DALI-2, MB HF2 COM1 and MB HF2 DALI-2.

### Benefits

- User-related remote controls: Service remote controls and user remote controls
- Can be connected without the need for tools, compact design
- Detection through non-metallic materials, can be installed out of sight inside the luminaire
- Range and run-on time adjustable
- Selectable constant-lighting control with light-level teach-in function (Teach; DALI-2 versions)
- Current ambient brightness can be adopted (TEACH function)

## Further information on the individual sensors

<b>MB HF1 COM1, HF1 DALI-2, HF2 COM1 and HF2 DALI-2 .....</b>	<b>3</b>
Sensor technical specifications .....	3
Dimensional drawings .....	4
Sensor detection zones .....	5
Wiring .....	5
Safety precautions .....	6
Remote controls for DALI-2 versions .....	6
Description of buttons / functions .....	6
Feedback indicator flash pattern .....	7
Remote control RCS1 for COM1 versions .....	7
Description of buttons / functions .....	7
Settings via potentiometer .....	8
Twilight setting (response threshold) .....	8
Time setting (switch-OFF delay) .....	8
Reach setting (sensitivity) .....	8
Installation advice .....	8
Factory settings .....	8
Conformity / marks of conformity .....	8
Note .....	8


## MB HF1 COM1, HF1 DALI-2, HF2 COM1 and HF2 DALI-2

### Sensor technical specifications


	MB HF1 COM1	MB HF1 DALI-2	MB HF2 COM1	MB HF2 DALI-2
Article number	110042808	110051733	110059684	110059685
GTIN	-	4007841062910	-	4007841062927
Type	9000	9008	9009	9010
Dimensions	52 × 40 × 32mm Hole spacing 62mm	52 × 40 × 32mm Hole spacing 62mm	63 × 40 × 42mm Hole spacing 71mm	65 × 40 × 42mm Hole spacing 71mm
Features	Motion detector Light sensor Feedback indicator Parameterization interface Potentiometer	Motion detector Light sensor Constant light control Feedback indicator Parameterization interface	Motion detector Light sensor Feedback indicator Parameterization interface Potentiometer	Motion detector Light sensor Constant light control Feedback indicator Parameterization interface
Sensor technology	High-frequency technology Patch antenna	High-frequency technology Patch antenna	High-frequency technology Rod antenna	High-frequency technology Rod antenna
Transmitter power	1 - 2mW	1 - 2mW	1 - 2mW	1 - 2mW
Transmission frequency	5,8GHz	5,8GHz	5,8GHz	5,8GHz
Light measurement range	2 - 2000lx	2 - 2000lx	2 - 2000lx	2 - 2000lx
Angle of coverage	360° with 110° angle of aperture	360° with 110° angle of aperture	360° with 160° angle of aperture	360° with 160° angle of aperture
Reach	max. Ø 5m for mounting height 5m	max. Ø 5m for mounting height 5m	max. Ø 8m for mounting height 4m	max. Ø 8m for mounting height 5m
Power supply	100 – 240V, 50/60Hz	220 – 240V, 50Hz	100 – 240V, 50/60Hz	220 – 240V, 50Hz
Output	300W / 10A, max. 2 EVG	max. 15 EVG	300W / 10A, max. 2 EVG	max. 15 EVG
Supply current DALI-2	-	30mA guaranteed (15 ballasts), max. 250mA	-	30mA guaranteed (15 bal- lasts), max. 250mA
Connection	0.5 – 2.5mm <sup>2</sup>	0.5 – 2.5mm <sup>2</sup>	0.5 – 2.5mm <sup>2</sup>	0.5 – 2.5mm <sup>2</sup>
IP rating:	IP20	IP20	IP20	IP20
Protection class	II	II	II	II
Temperature range	-20°C to +60°C (tc +60°C)	-20°C to +60°C (tc +60°C)	-20°C to +60°C (tc +60°C)	-20°C to +60°C (tc +60°C)
Approval marks / Conformity	CE, ENEC	CE	CE	CE
Setting via	Remote control RCS1 Potentiometer	Remote control RCS2 Remote control RCS4	Remote control RCS1 Potentiometer	Remote control RCS2 Remote control RCS4

## Dimensional drawings


MB HF1 COM1

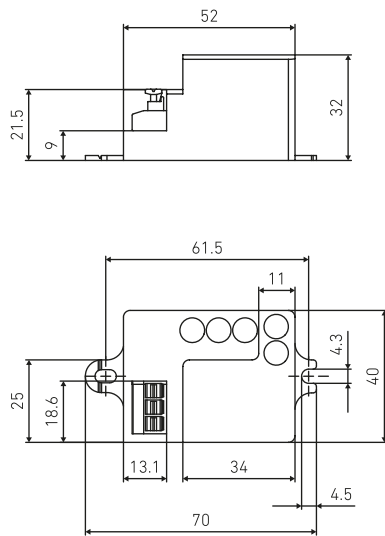


MB HF2 COM1

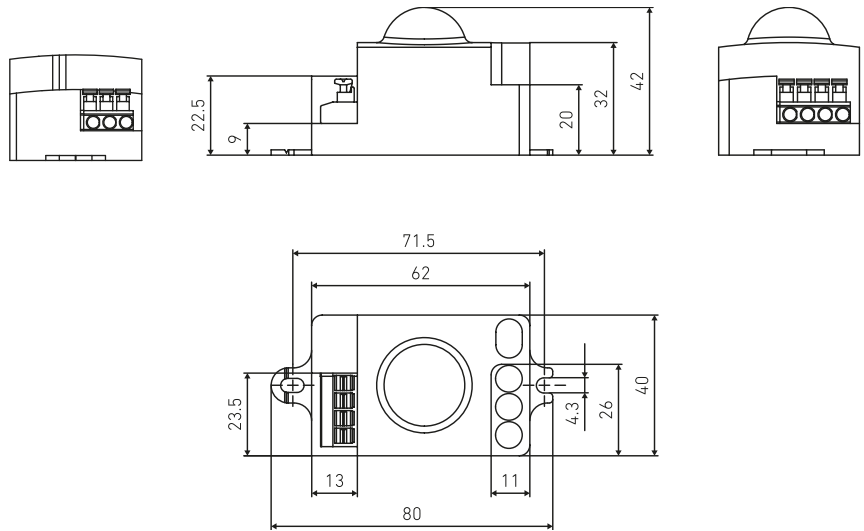

MB HF1 DALI-2

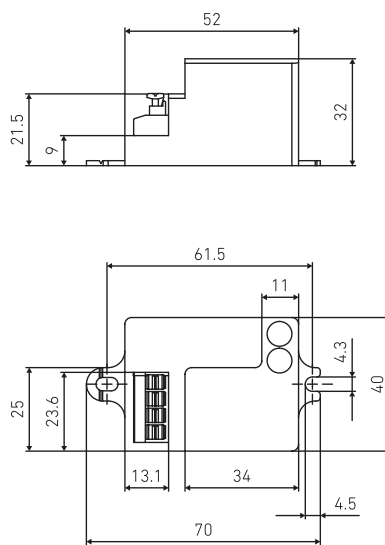





MB HF2 DALI-2

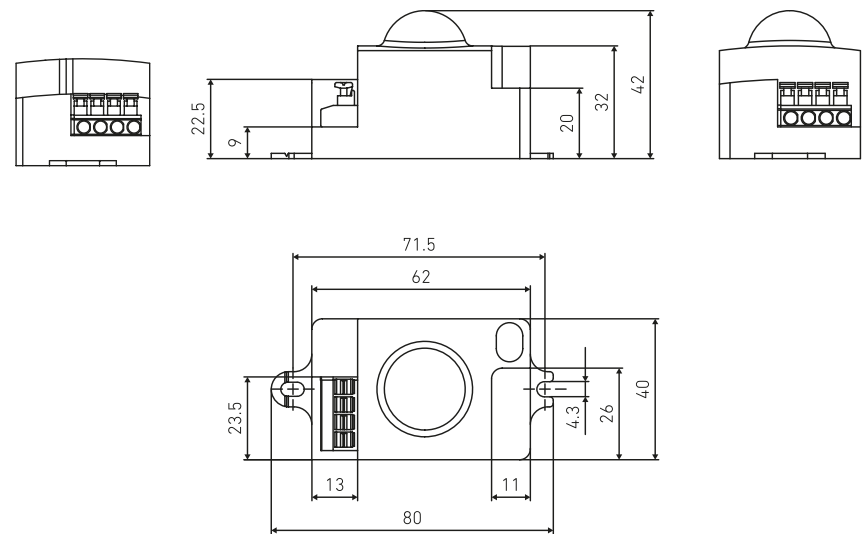

## Sensor detection zones


MB HF1 COM1 / DALI-2

MB HF2 COM1 / DALI-2

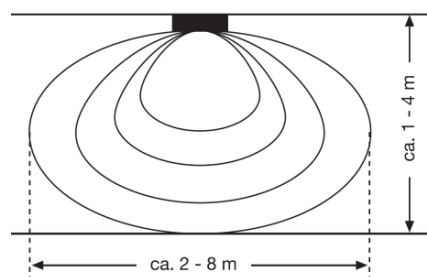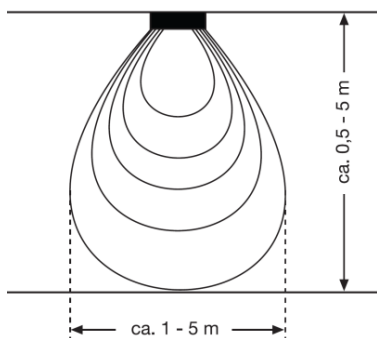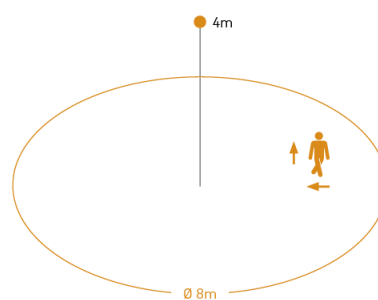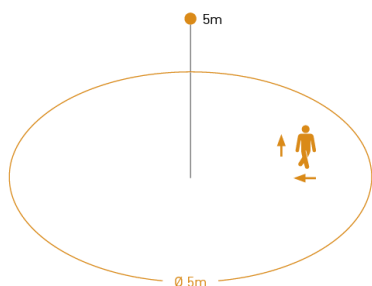


## Wiring

Luminaire with a DALI-2-capable ballast

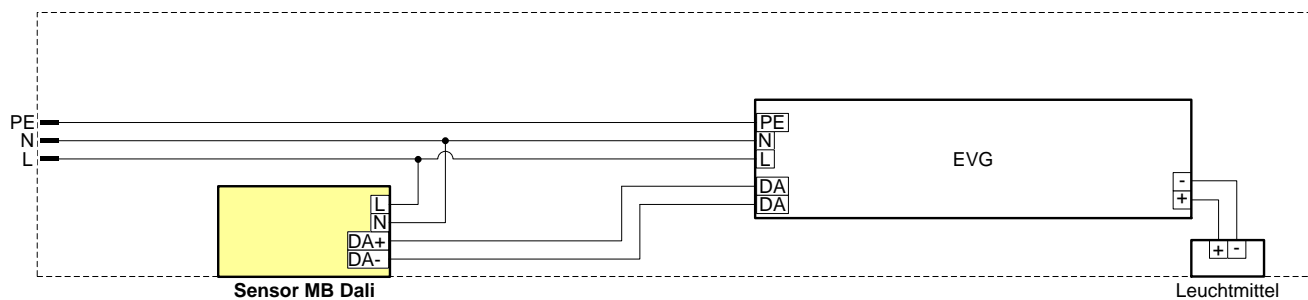


Luminaire with a traditional ballast

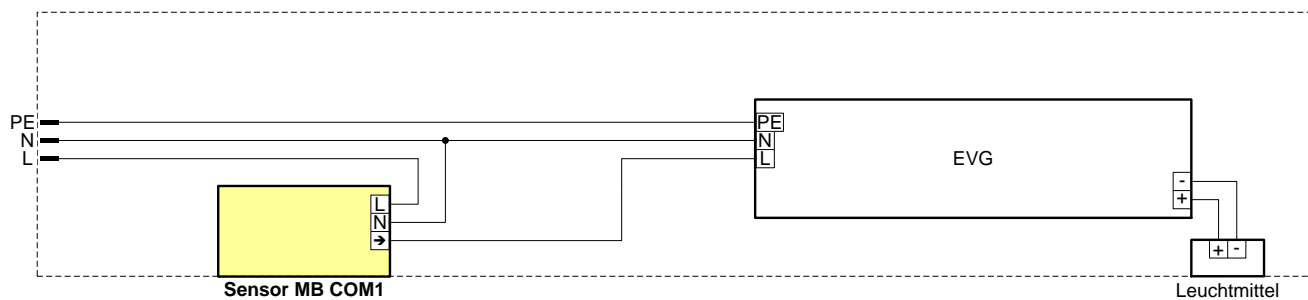


## Safety precautions

- Electrical devices must only be assembled and installed by qualified electricians.
- Fire hazard. The maximum permissible load must not be exceeded.
- Risk of electric shock. Disconnect before attempting work on the unit or load. Take into account all circuit breakers supplying dangerous voltages to the unit or load.
- Risk of electric shock. Before installing the sensor, check the enclosure to make sure it is not damaged. Never open the enclosure.
- Keep button cell batteries away from children. Immediately seek medical advice if button cell batteries are swallowed.
- Explosion hazard. Do not recharge batteries. Do not throw batteries into fire.
- The sensor is not suitable for use in burglar alarm systems or other alarm equipment.

## Remote controls for DALI-2 versions

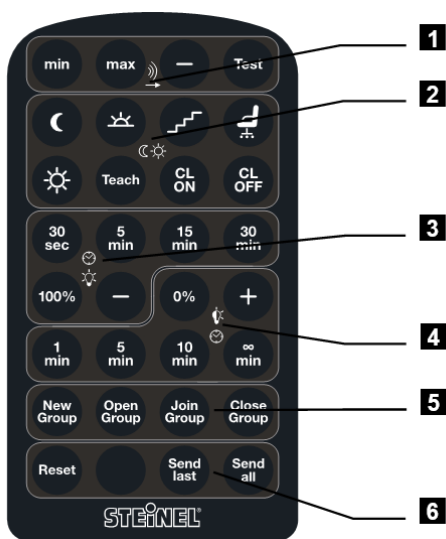

RCS2 (service remote control)

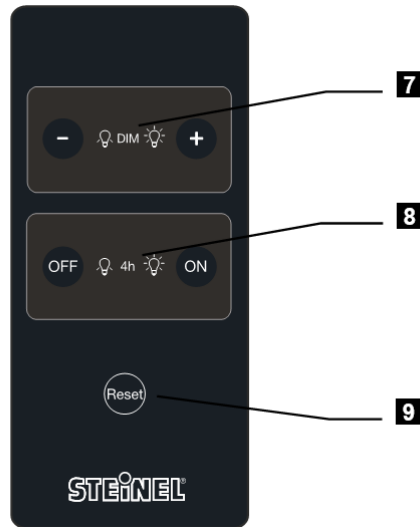

RC4 (user remote control)

## Description of buttons / functions

### **1** Reach setting / test mode

Reach can be set directly to minimum or maximum ("min, max" buttons) and, if necessary, reduced in 10% steps ("- button). In test mode ("Test" button), reach can be checked with a shortened stay-ON time of 5 seconds. When selecting test mode, daylight operation is activated and basic light switched OFF. The mode is terminated manually by re-pressing the "Test" button, otherwise automatically after 2 minutes.

### **2** Activation basis / constant lighting control

When constant-lighting control is deactivated ("CL OFF" button), any movement / human presence will only switch the main light ON if ambient light is below the selected ambient light level thresholds ("moon, twilight, stairs, office" buttons, approx. 2, 40, 100, 300 lx). If the luminaire is currently providing basic light or if daylight operation is activated ("Sun" button), it switches directly to main light. It is also possible to teach in the current ambient light level ("Teach" button). If constant-lighting control is activated ("CL ON" button), specific light-level settings can be programmed for controlling lighting ("Moon, Twilight, Stairs, Office" buttons, approx. 500, 600, 700, 800 lx). Teaching brightness is more practical and provides greater precision. To do this, the chosen level of brightness must be selected via main light level or light adjustment before starting the teaching cycle ("Teach" button).

### **3** Main light level / stay-ON time

The main light level can be set directly to maximum ("100%" button) and, if necessary, reduced in 5% steps ("- button) down to a minimum main light level of 55%. The main light stay-ON times can be set to between 30 seconds and 30 minutes ("30 sec, 5 min, 15 min, 30 min" buttons). Main light is activated in response to movement if the activation condition is met. Once the stay-ON time has elapsed, the light returns to basic light (if this is activated) or the luminaire switches OFF if basic light is deactivated.

### **4** Basic light level / stay-ON time

The basic light level can be set directly to minimum ("0%" button) and, if necessary, increased in 5% steps ("+" button) to a maximum basic light level of 45%. At 0% basic light, basic light is permanently deactivated. The basic light stay-ON times can be set to between 1 minute and 10 minutes ("1 min, 5 min, 10 min" buttons). It is also possible to activate basic light so that it stays on all the time ("∞ min" button).

### **5** Grouping

No function

### **6** Parameter reset

If necessary, the current parameter set can be reset to factory settings ("Reset" button on RCS1).

#### 7 Light adjustment

If necessary, the current light level can be adjusted in 5% steps ("DIM +, -" buttons). The newly adopted value will be maintained until the next time the luminaire is switched ON/OFF.

#### 8 Override mode

Override mode ("4 h ON, OFF" buttons) deactivates normal sensor operation for 4 hours. When override mode is selected for permanent lighting, the luminaire permanently assumes the configured main-light level. Permanently OFF switches the luminaire OFF permanently and in spite of any movement activity. This, for example, is required during presentations. Light can also be adjusted in override mode.

#### 9 State reset

Although clearing parameters intentionally via remote control is not possible, it can be used to terminate the current operating state, return to sensor mode and assume the initial state = "no movement / light OFF" ("Reset" button on RC4 remote control).

### Feedback indicator flash pattern

	Meaning	Application
Short flash (1 x 100ms)	"Confirmation"	Remote control command successfully processed
Double flash (2 x 100ms)	"Completed"	State has been reset / teach cycle completed / test mode terminated
Triple flash (3 x 100ms)	„Reset“	Parameters have been reset
Long flash (1 x 700ms)	„Fault“	No unused group code available / maximum basic light already reached / minimum main light already reached / minimum reach already reached

### Remote control RCS1 for COM1 versions



### Description of buttons / functions

#### 10 Reach adjustment

Reach can be set directly using the percentage buttons and additionally increased by pressing + and reduced by pressing – (in 5% steps).

#### 11 Stay-ON time

The buttons for stay-ON time can be set to the fixed, programmed values. In addition, the stay-ON time can also be increased and reduced via the + and – buttons. The + button increases the stay-ON time by 10 s to 1 min, then in 1 min increments to a maximum of 60 min. The – button shortens the stay-ON time by 1 min down to 1 min, then by 10 s down to a minimum of 10 s.

#### 12 Activation basis

The sensor's response threshold can be set to the fixed, programmed values via the symbol buttons. The "Teach" button sets the light level currently measured as the response threshold.

### 13 Test / Burn in / Reset

Pressing the Test button activates the test mode. In this mode, the stay-ON time is 5 seconds and the light level is ignored. The test mode is exited automatically 2 minutes after it is activated and the sensor switches to automatic mode. The burn-in function is activated by pressing the "Burn in" button. The Reset button returns the values to factory setting.

### Settings via potentiometer

As an alternative to setting parameters via remote control, the settings for the COM versions can also be selected using the potentiometers. The parameters previously selected by infrared remote control will then be overwritten. Reach can be adjusted from 0% to 100%. The switch-ON threshold can be adjusted from approx. 2 lx to 2000 lx and the stay-ON time from 10 seconds to 30 minutes.

### Twilight setting (response threshold)

The chosen sensor response threshold is infinitely adjustable from approx. 2 lux to 2000 lux. Turning the setting control fully clockwise selects daylight operation at approx. 2000 lux (factory setting). Turning the setting control fully anti-clockwise selects night-time operation at approx. 2 lux. When adjusting the detection zone and performing the walk test in daylight, the setting control must be turned fully clockwise.

### Time setting (switch-OFF delay)

The connected luminaire can be set to stay on for any period from approx. 10 sec. to a maximum of 30 min., up to a maximum of 60 min. via remote control. Turning the setting control fully anticlockwise selects the shortest time of approx. 10 sec. (factory setting). Turning the setting control fully clockwise selects the longest time of approx. 30 min. The switch-off delay is re-started by any movement detected before this time elapses. Every time the light switches off, it takes approx. 2 seconds for the sensor to start detecting movement again. The sensor is only able to detect movement again once this time has elapsed.

### Reach setting (sensitivity)

Die gewünschte Reichweite des Sensors kann stufenlos eingestellt werden. Stellschraube Linksanschlag bedeutet minimale Reichweite. Stellschraube Rechtsanschlag bedeutet maximale Reichweite. Die Reichweite kann je nach Raumbedingungen variieren.

### Installation advice

- For indoor use only.
- The sensor must project beyond the lamp. The angle of aperture must reach at least 45%.
- Pay attention to luminaire materials (interference, reflections, attenuation).
- The connected electronic ballast must not exceed the specifications at any time.

### Factory settings

	MB HF1/2 COM1	MB HF1/2 DALI-2
Reach	Potentiometer (100%)	100%
Switch-ON threshold	Potentiometer (daytime operation)	Office
Constant lighting control	-	deactivated
Main light level	-	100%
Main light stay-ON time	Potentiometer (minimum, 10s)	5min
Basic light level	-	0%
Basic light stay-ON time	-	5min

### Conformity / marks of conformity



Link: 



Electronic control device with double insulation in compliance with DIN EN 61347  
The control connections DA+/DA- to active parts are basic isolated.

### Note

As attenuation and reflections can cause a high-frequency sensor to behave differently in any luminaire, we cannot accept any liability for the sensor not working as expected in the particular luminaire it is being used in. However, we are able to provide accreditation. Please contact our OEM Account Manager to find out what assistance we can give you in designing the sensor module into a luminaire. The customer must also guarantee and take responsibility for the way in which the other components behave in the luminaire (lamp, ballast etc.).

This product data sheet provides no guarantee of qualities within the meaning of the statutory warranty provisions for the product described.